


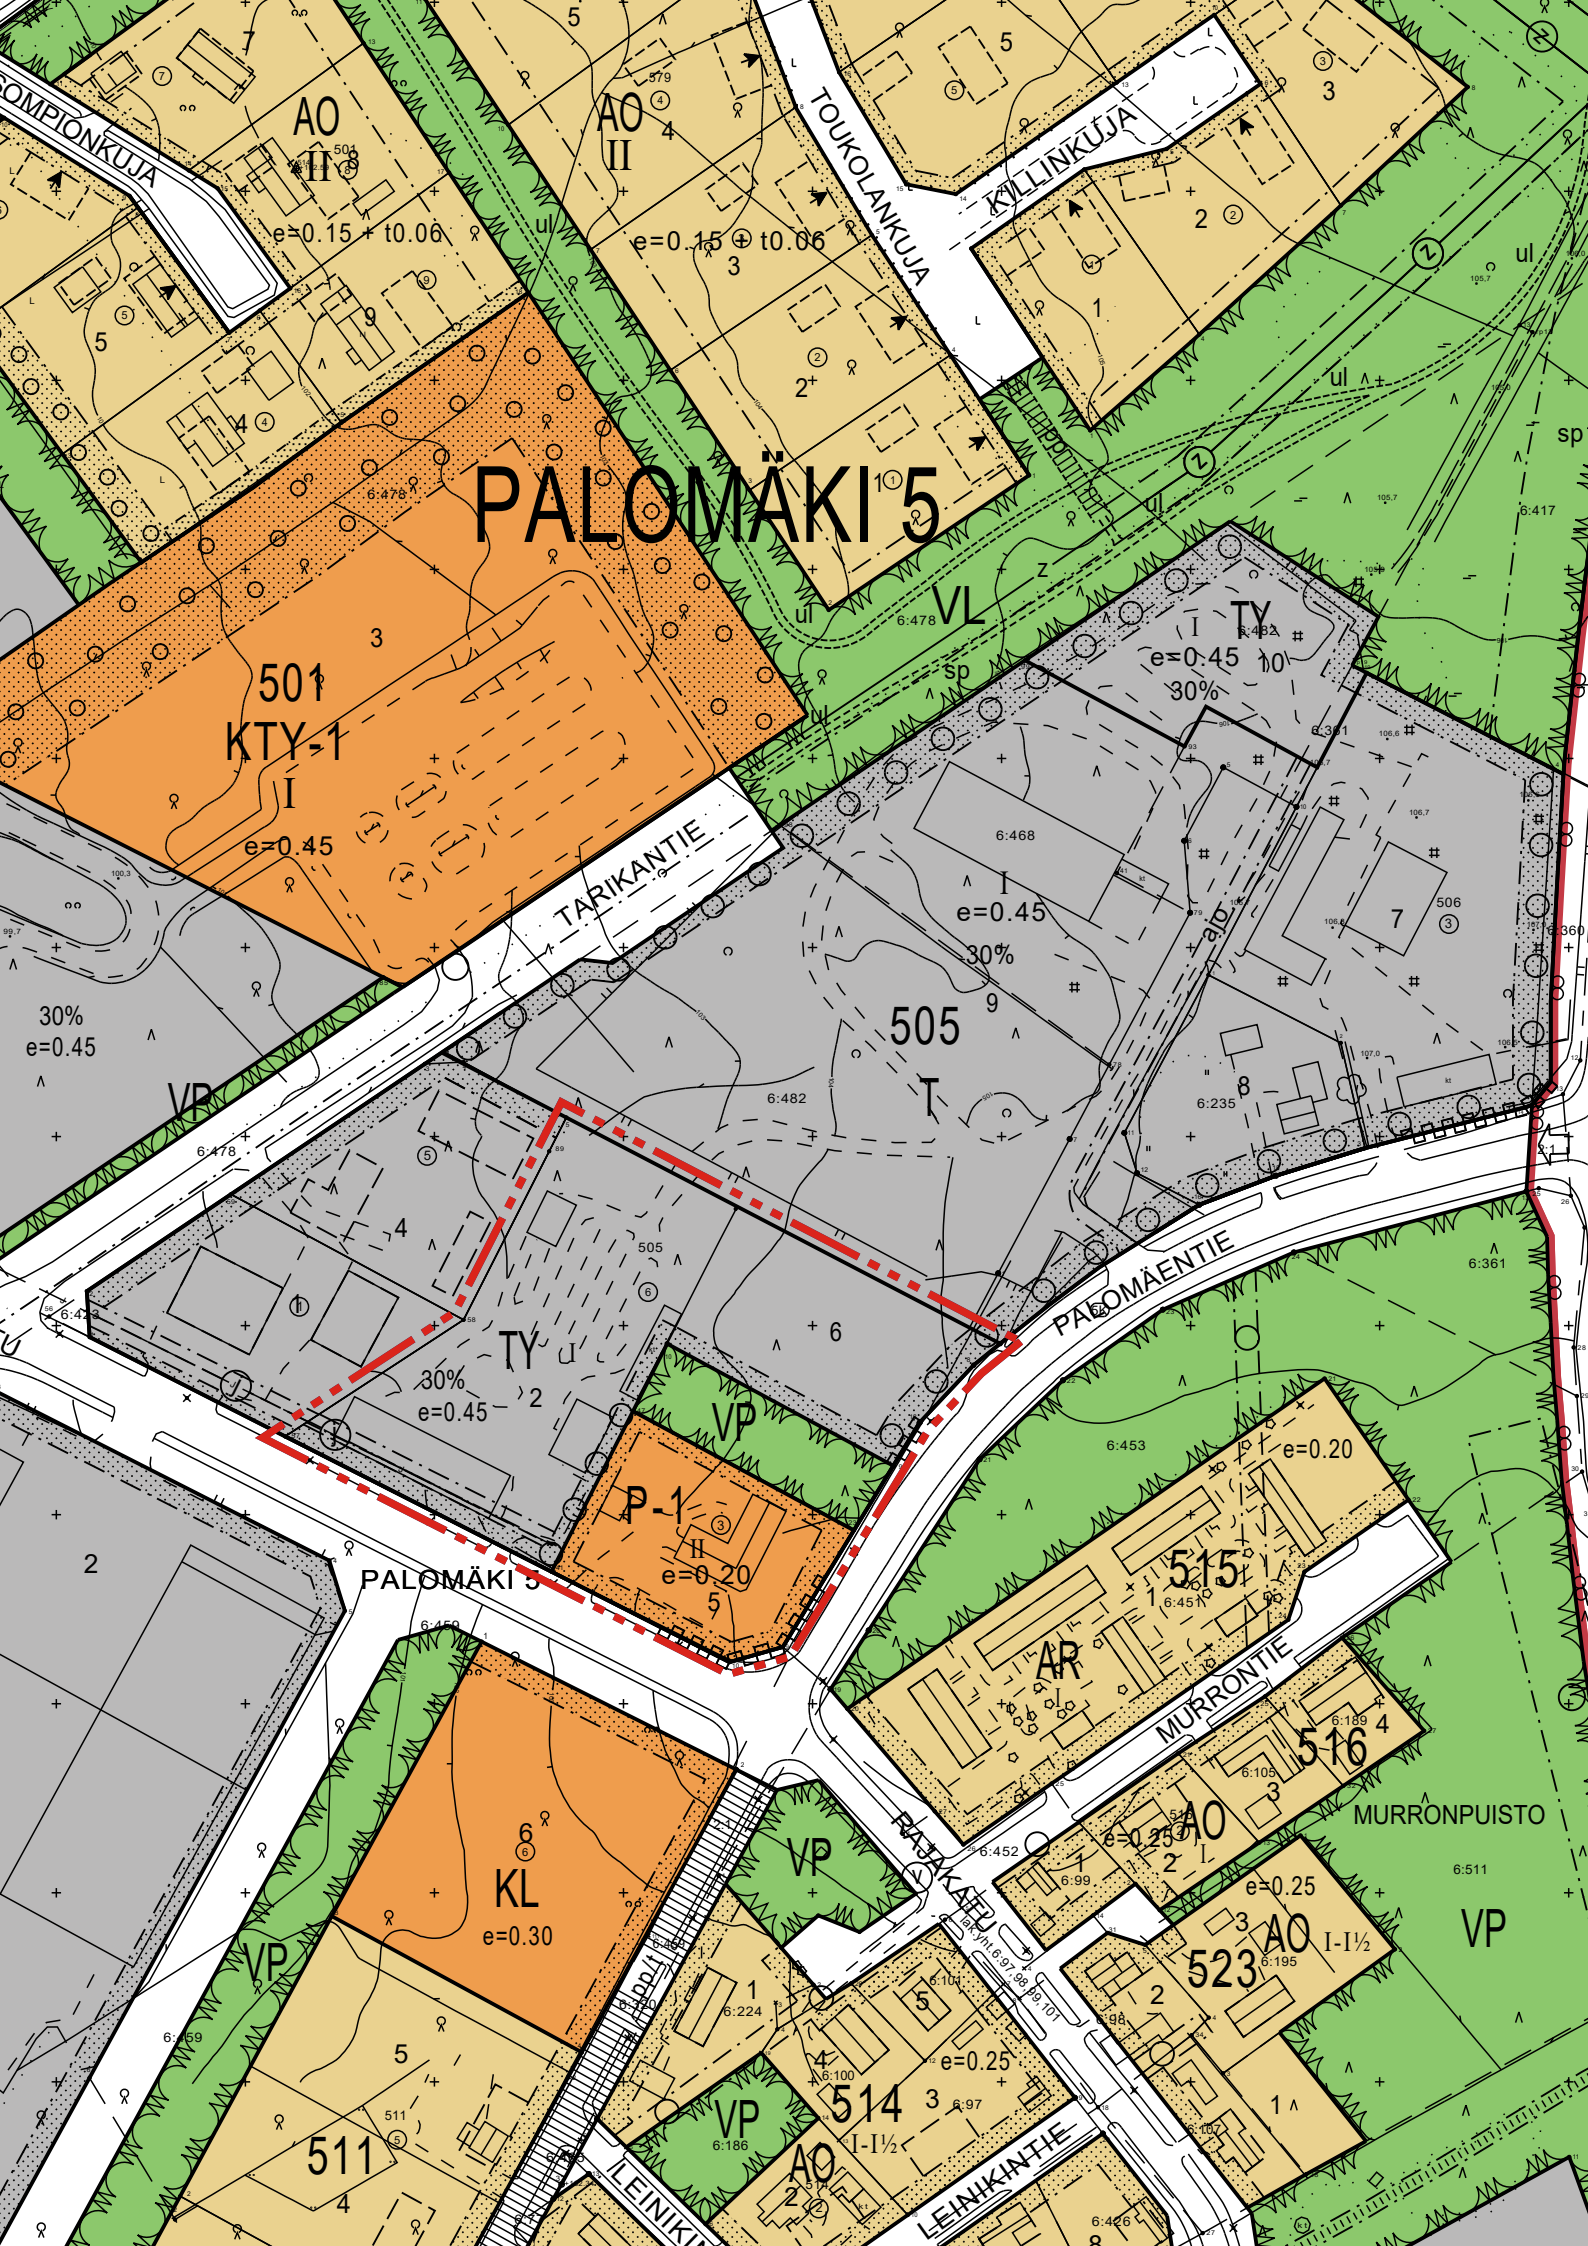

PALOMÄKI 5

501
KTY-1
I
e=0.45

TARIKANTIE

505
T
e=0.45
30%

TY
e=0.45
30%

TY
e=0.45
30%

P-1
II
e=0.20

PALOMÄKI 5

KL
e=0.30

515
AR
e=0.20

MURRONPUISTO

516
AO
e=0.25

523
AO
e=0.25

514
VP
e=0.25

514
AO
e=0.25

514
AO
e=0.25

514
AO
e=0.25

514
AO
e=0.25

514
AO
e=0.25

514
AO
e=0.25